

Heat Transfer Enhancement in divergent duct

Prof. Renu Yeotikar¹

¹Department of Mechanical Engineering

STES's Smt. KashibaiNavale College of Engineering, Pune, INDIA

ABSTRACT-The technique of attaching ribs to the flow passages has become one of the wide uses in many industrial applications. Ribs increases the turbulent kinetic energy caused by the flow disturbances, increases the rate of heat transfer in the duct. From the past researches, it is also observed that for a smooth straight duct/channel, a small variation in the cross-sectional area may produce significant difference in the local and the average heat transfer patterns. In this study, CFD simulations are presented to assess forced convection heat transfer and pressure drop for the air flow through a divergent duct with triangular ribs in staggered and inline arrangement. Measurements are supposed to be carried out on flat aluminium plate in divergent channel for triangular ribs with aspect ratio of 2 and rib height $e=3$ mm with varying p/e ratios, at fixed angle of attack as 45° at Reynolds numbers considered in a range of 4000 to 7000. The CFD results show that there is a significant effect on heat transfer rate over smooth divergent duct due to the presence of rib and concluded that the inline arrangement of ribs gives best heat transfer augmentation than staggered for the same mass flow rate.

Keywords– Divergent duct, Ribs, Nusselt Number, Heat transfer coefficient, Reynolds Number, pressure drop, CFD

1. INTRODUCTION- In order to obtain higher power output from the gas turbine engines, the turbine inlet temperature had been increased in the recent engines. This high temperature could lead to overheating of the blades and may result in blade failure. In order to prevent such failures, the blade surfaces must be maintained to acceptable limits. So, the cooling of blade surfaces must be considered. There are various methods to cool the turbine blade and one of the most popular methods is by using rib turbulators. Many other heat transfer augmentation techniques are also used such as fins, ribs, dimpled surfaces, and protruding surfaces that generate vortices in a heat exchanger. Rib turbulators are used in gas turbine airfoils for increasing the heat transfer rate via turbulence, heat exchangers and the mixing of fluids. Rib turbulators have major scope in the applications such as rotating drums, sterilizers, heat transfer ovens, mixing and pelletizing machines, and air de-stratification fans for horticultural and agricultural uses. Rib Turbulators are an efficient and economical way of heat transfer augmentation. Repeated ribs have been used as the promoters of turbulence to enhance the heat transfer to the flow of coolants in a channel. These roughness elements break the laminar sub-layer of the flow. The heat transfer is enhanced as well as the pressure drop is an important parameter in the analysis of the overall performance of such flows. There are many investigations have been performed to study the effect of ribs in the channel on improvement of heat transfer.

2. LITERATURE REVIEW

Experiments were conducted to evaluate the thermal performance for the straight rectangular channel with rib turbulators of different cross-sections such as triangular, right-angle triangular and rectangular. Ribs were placed on opposite walls of the channel. Heat transfer coefficients and frictional loss were calculated. The results obtained for all the ducts with different rib shapes proved that the isosceles triangular shaped rib had given best heat transfer performance with in-line rib arrangement PongjetPromvonge, et al.

Investigations are evaluated by conducting the experiment to assess the thermal performance for the rectangular channel fitted with triangular ribs of different heights with in-line and staggered arrays. The flow rate in terms of Reynolds numbers was considered in a range of 5000 to 22,000. They found that the in-line rib arrangement provides more heat transfer and friction loss than the staggered one for the same flow rate. Comparison among ribbed channel and smooth channels is done and they found that the largest e/H of 0.13 rib with inline array performed best in terms of both the Nusselt number and the friction factor C_f . Thianpong et al. Numerical investigation on turbulent forced convection in a channel with different shapes of ribs such as square, rectangular, trapezoidal and triangular was done using water as the flowing fluid in their experiment. The main aim of said analysis was to assess the heat transfer rate of the straight channel with ribs by the use of fluent code v6.3. The flow rate in terms of Reynolds numbers was considered in the range between 20000 and 60000. It is found that the most significant thermal performances are provided by triangular ribs with $w/e=2.0$ OronzioManca et al.

Thermal performance was presented to investigate the heat transfer to the fluid flow through a straight channel with triangular ribs of different angles. The flow rate in terms of Reynolds numbers was considered in a range from 20000 to 60000 by using Ansys Icem & Fluent V14. It is found that the highest value of average Nusselt number was obtained for triangular ribs of angle 60° compared to the Nusselt number for the ribs of angle 90° and 45° at Reynolds number of 60000 TuqaAbdulrazzaq et al .

Experimental investigation was carried out to evaluate the thermal performance in a narrow diverging channel with and without ribs with a representative Reynolds number of 28000. This analysis showed ribbed ducts provided higher heat transfer coefficients Justin Lamont et al . Experimental investigation was done to assess heat transfer and pressure drop of turbulent flows with a fixed rib height through the rectangular convergent and divergent channels with square ribs. The flow rate in terms of Reynolds numbers was considered in a range from 15,000 to 89,000. Comparison of the thermal performance of the ribbed

rectangular divergent/convergent channels with the ribbed square straight channel showed that among the four types of channels, the divergent channel of D2($D_h/D_i=1.49$) performed best at the same mass flow rate M.S.Lee et al.

3. METHODOLOGY AND DESIGN

3.1 Concept of Rib turbulators:

Attaching of ribs to the flow passages has become one of the most widely used mean of heat transfer enhancement techniques and has many industrial applications such as cooling passages of gas turbine blade, compact heat exchangers, fuel elements in advanced gas-cooled reactor, electronic cooling devices, etc. The flow disturbances due to the rib arrays greatly increase the production of turbulent kinetic energy which enhances the turbulent heat transfer in channel.



Fig.1 different Shapes of Ribs promoters

The shape of rib cross section affects the formation of separation bubble behind the rib and amount of turbulent kinetic energy production, thus the rib shape is the major factor that determines the heat transfer performance.

3.2 Test Geometry Model:

Fig. 2 shows the geometry which has been considered in this simulation to study effect of ribs on heat transfer. The total length of channel is 500mm. Three pitch by height ratios are presented ($p/e=8, 10$ & 12) with Reynolds number range from 4270 to 6398.

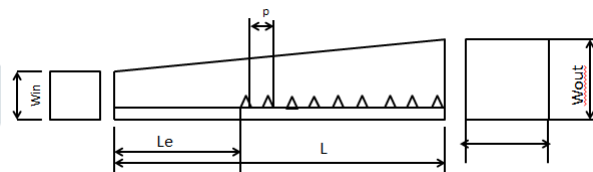


Fig.2 Test Geometry

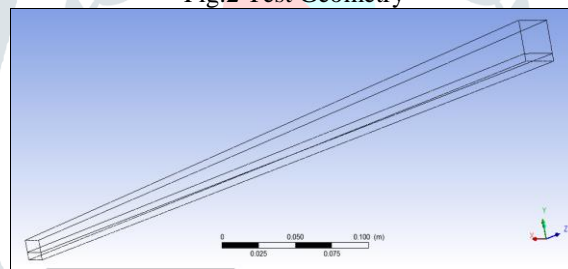


Fig. 2.a. plain divergent duct

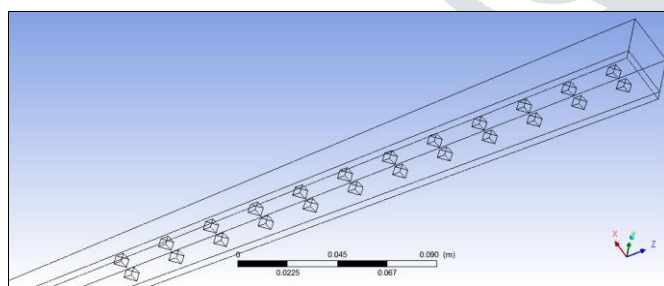


Fig. 2.b. Divergent duct with ribs inline arrangement

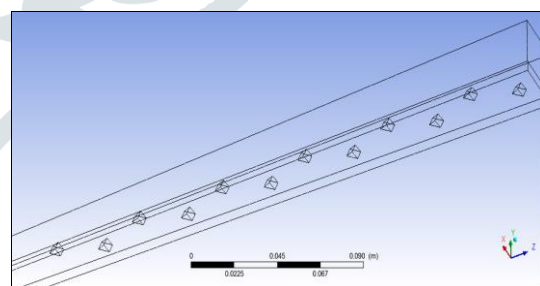


Fig. 2.c. divergent ribbed duct with staggered

3.5 CFD Methodology

3-Dimensional, Steady-state CFD simulations are performed using ANSYS FLUENT V15.0. A second order upwind scheme for momentum and energy equations are considered with SIMPLE coupling for couple velocity and pressure drop. This project work includes the convection heat transfer from the solid surfaces to the adjacent air; and the conductive heat transfer in the triangular ribs.

The pressure based solver is chosen for the simulations with the consideration to the low speed flows in this problem. Air density and other properties such as viscosity, specific heat will be considered as constant values. The Realizable k-epsilon turbulence model is applied for the simulation.

3.5.1 Boundary conditions:

The following appropriate boundary conditions were imposed on the model.

- Inlet: Velocity inlet boundary condition [velocity, static temperature].
- Outlet: Pressure Outlet [atmospheric pressure].
- Heat source: constant heat flux
- Walls: constant Adiabatic, No-slip, stationary wall

Test geometry Meshing tool ICEM 15 has been used and these are shown as following:

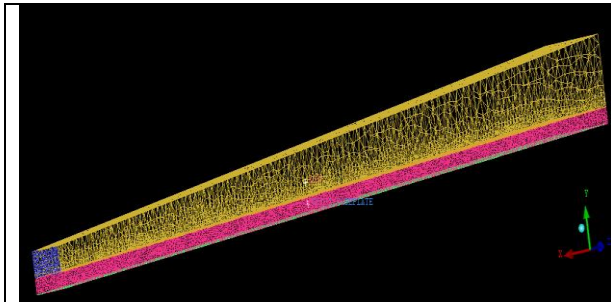


Fig. 4 meshing for plain divergent duct

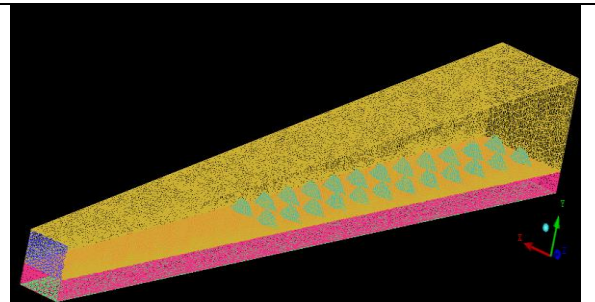


Fig.5 meshing for ribbed divergent duct with inline

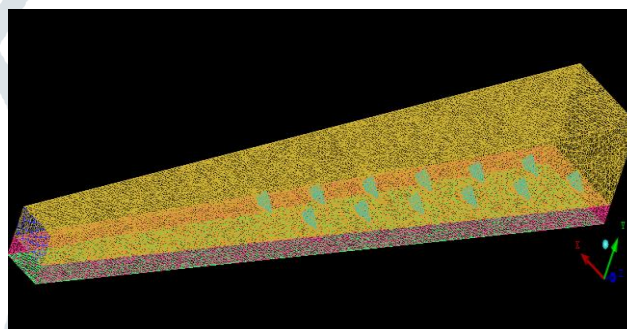


Fig. 6 meshing for ribbed divergent duct with staggered arrangement

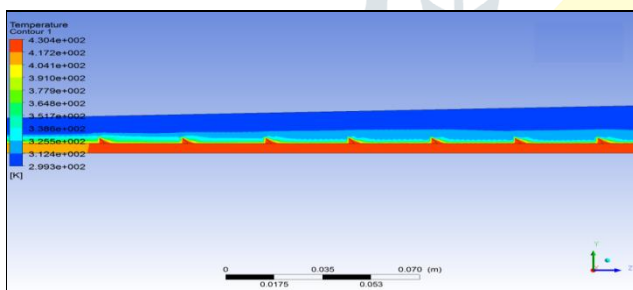


Fig. 8 Temperature Contour for ribbed divergent duct

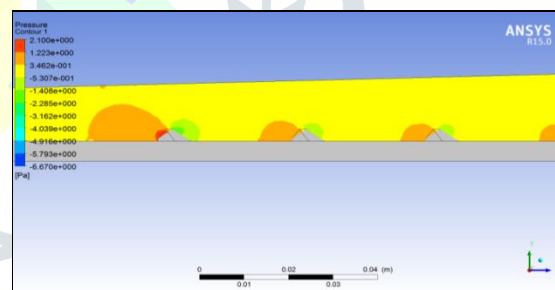


Fig. 9 pressure contour for ribbed divergent duct

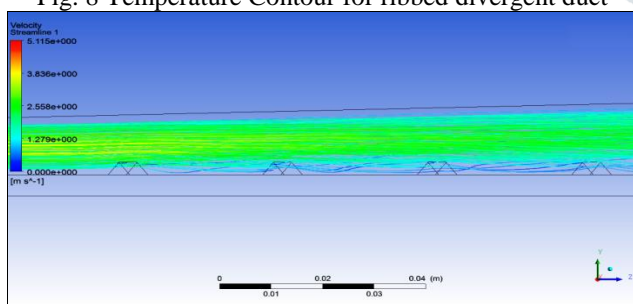


Fig.9 Velocity Streamline for ribbed divergent duct

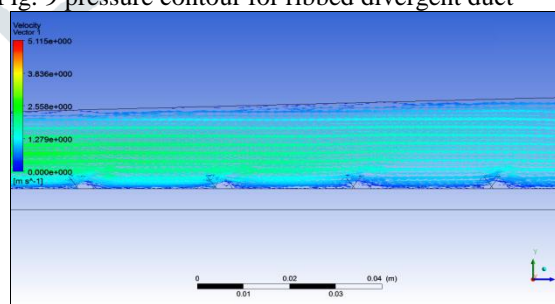


Fig. 10 Vector Velocity for ribbed duct

4. Results and Discussion:

Figure 11 shows variation of heat transfer coefficient with Reynolds Number. This graph indicates that there is higher heat transfer coefficient for inline rib with $p/e=8$ than staggered ribs and plain duct. It varies from 25% to 50% than plain divergent duct.

Figure 12 shows variation of Nusselt number with Reynolds Number. This graph indicates that there is higher heat transfer enhancement in terms of Nusselt number for inline rib with $p/e=8$ than staggered ribs and plain duct. It varies from 20% to 45% than plain duct. Figure 13 Shows the variation of friction

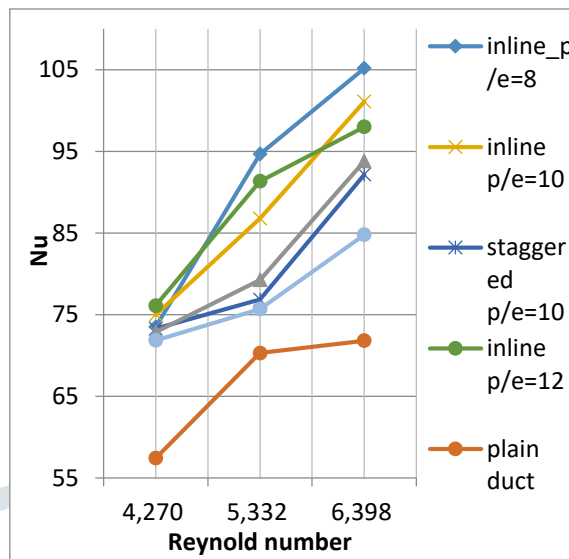
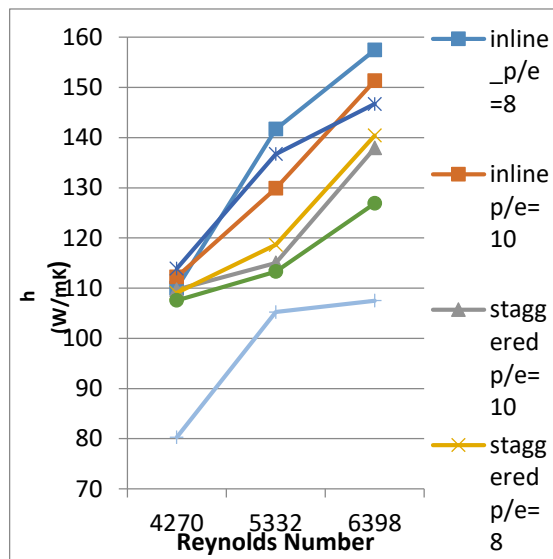


Fig. 11 Variation of heat transfer coefficient with Re

Fig. 12 Variation of Nusselt Number with Re

f

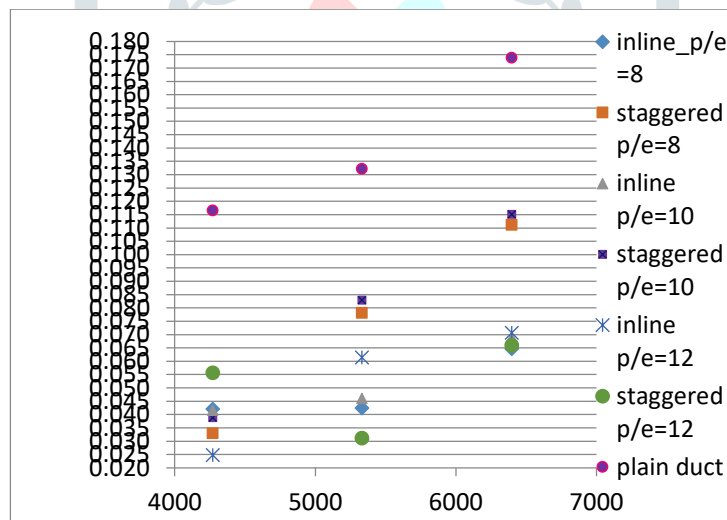


Fig. 13 Friction factor Vs Re

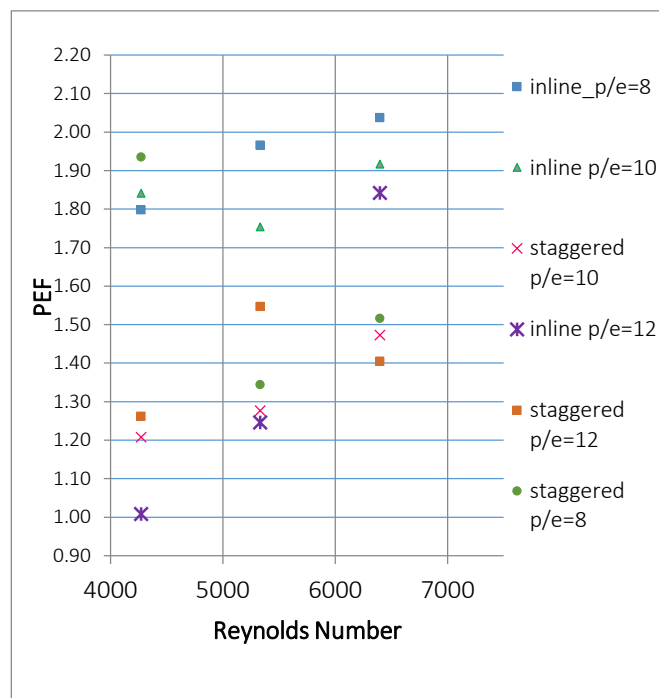


Fig. 14 Performance enhancement factor

9. Conclusions

CFD simulation study on heat transfer to air flow in the divergent channel with triangular ribs with inline and staggered rib arrangements is conducted and compared with smooth divergent channel in the present study. Following are the conclusions of this work.

1. The results indicate that the Nusselt number increases with increase in Reynolds Number for all cases
2. The greatest improvement of heat transfer is observed at the Reynolds Number of 6398 for the inline arrangement of triangular ribs with p/e ratio of 8.
3. Highest value of Performance Enhancement factor is found to be $PEF = 2.04$ for the inline rib arrangement and optimum p/e ratio is found to be at p/e=8

5. REFERENCES

1. S. M. Mousavi G, F aramarzFaraji, Abbas Majazi, Kamal Al-Haddad A comprehensive review of flywheel energy storage system journal on renewable and sustainable energy review 67 (2017) 477-490
2. Elisa Isotahdon, ElinaHuttunen-Saarivirta, Veli-TapaniKuokkala Characterization of the microstructure and corrosion performance of Ce-alloyed Nd-Fe-B magnets on journal of alloys and compounds 692 (2017) 190-197
3. Michel A Conteh, Emmanuel C. Nsofor Composite flywheel material design of high-speed energy storage on journal of applied research and technology 14 (2016) 184-190
4. Chung-Neng Huang, Yui-Sung Chen Design of magnetic flywheel control for performance improvement of fuel cells used in vehicles journal on Energy (2016) 1-13
5. Jingying Huang, Datong Qin, ZhiyuanPeng Effect of energy-regenerative braking on electric vehicle battery thermal management and control method based on simulation investigation on journal of Energy conversion and management 105 (2015) 1157-1165