

IMPROVING THE POWER QUALITY OF DISTRIBUTION SYSTEM BY USING MODIFIED UPQC CONTROLLER

¹Ch.Shravan kumar Reddy, ²P.Hemanth kumar, ³Dr.J.Kartigeyan

¹Asst. Professor, Dept. of EEE,J.B Institute Engineering of Technology, Hyderabad, Telangana.

²Research scholar, Dept. of EEE,JNTU Hyderabad, Telangana.

³Associate Professor, Dept. of EEE,J.B Institute Engineering of Technology, Hyderabad, Telangana.

ABSTRACT

This project presents an improved controller for the dual topology of the unified power quality conditioner (UPQC) extending its applicability in power-quality compensation, as well as in microgrid applications. Power quality has become an important factor in power systems, for consumer and household appliances with proliferation of various electric and electronic equipment and computer systems. The main causes of a poor power quality are harmonic currents, poor power factor, supply-voltage variations, etc. A technique of achieving both active current distortion compensation, power factor correction and also mitigating the supply-voltage variation at the load side, is compensated by unique device of UPQC and a modified synchronous-reference frame based control method to shunt active filter and instantaneous power quality theory based control technique for series active filter to compensate power quality problems. By using this controller, beyond the conventional UPQC power quality features, including voltage sag and swell compensation, the UPQC will also provide reactive power support to regulate not only the load-bus voltage but also the voltage at the grid-side bus. In other words, the UPQC will work as a static synchronous compensator (STATCOM) at the gridside, while providing also the conventional UPQC compensations at the load or microgrid side.

Index Terms - UPQC, micro grids, power quality, static synchronous compensator (STATCOM), unified power quality conditioner (UPQC).

1. INTRODUCTION

The modern power distribution system is becoming highly vulnerable to the different power quality problems. The extensive use of non-linear loads is further contributing to increased current and voltage harmonics issues. Furthermore, the penetration level of small and large scale renewable energy systems based on wind energy, solar energy, fuel cell, etc., installed at distribution as well as transmission levels is increasing significantly. Unified power quality control was widely studied by many researchers as an eventual method to improve power quality of electrical distribution system. The function of unified power quality conditioner is to compensate supply voltage flicker/imbalance, reactive power, negative sequence current, and harmonics. In other words, the UPQC has the capability of improving power quality at the point of installation on power distribution systems or industrial power systems. Therefore, the UPQC is expected to be one of the most powerful solutions to large capacity loads sensitive to supply voltage flicker/imbalance. The UPQC consisting of the combination of a series active power filter (APF) and shunt active power filter (APF) can also compensate the voltage interruption if it has some energy storage or battery in the dc link. The shunt APF is usually connected across the loads to compensate for all current related problems such as the reactive power compensation, power factor improvement, current harmonic, compensation, and load unbalance compensation whereas the series APF is connected in a series with the line through series transformers. It acts as controlled voltage source and can compensate all voltage related problems, such as voltage harmonics, voltage sag, voltage swell, flicker, etc. The proposed control technique has been evaluated and tested under non-ideal mains voltage and unbalanced load conditions using Mat lab/Simulink software. The proposed method is also validated through experimental study. The following diagram shows the generalized UPQC system. The UPQC consists of two voltage source inverters Connected back to back with each of them sharing a common dc link. One inverter work as a variable voltage source is called series APF, and the other as a variable current source in called shunt APF. The main aim of the series APF is harmonic isolation between load and Supply, it has the capability of voltage flicker/ imbalance compensation as well as voltage regulation and harmonic compensation at the utility-consumer PCC. The shunt APF is used to absorb current harmonics, compensate for reactive power and negative-sequence current, and regulate the dc link voltage between both APFs. The power circuit of a UPQC consists of a combination of a shunt active filter and a series active filter connected in a back-to-back configuration. This combination allows the simultaneous compensation of the load current and the supply voltage, so that the compensated current drawn from the grid and the compensated supply voltage delivered to the load are kept balanced and sinusoidal. The dual topology of the UPQC, i.e., the UPQC, where the shunt active filter behaves as an ac-voltage source and the series one as an ac-current source, both at the fundamental frequency. This is a key point to better design the control gains, as well as to optimize the *LCL* filter of the power converters, which allows improving significantly the overall performance of the compensator.

The STATCOM has been used widely in transmission networks to regulate the voltage by means of dynamic reactive power compensation. Nowadays, the STATCOM is largely used for voltage regulation, whereas the UPQC and the UPQC have been selected as solution for more specific applications. Moreover, these last ones are used only in particular cases, where their relatively

high costs are justified by the power quality improvement it can provide, which would be unfeasible by using conventional solutions. By joining the extra functionality like a STATCOM in the UPQC device, a wider scenario of applications can be reached, particularly in case of distributed generation in smart grids and as the coupling device in grid-tied micro grids.

2. SYSTEM CONFIGURATION

The general UPQC will be installed at substations by electric power utilities in the near future. The integration of the series-active and shunt-active filters is called the UPQC, associated with the unified power flow controller which has been proposed by Gyugyi. However, the UPQC for distribution systems is quite different. The aim of the specific UPQC is not only to compensate for the current harmonics produced by a 12-pulse thyristor rectifier of 20 kVA, but also to eliminate the voltage flicker/imbalance contained in the receiving terminal voltage from the load terminal voltage. The receiving terminal is often corresponding to the utility-consumer point of common coupling in high-power applications. The UPQC consists of a 1.5-kVA series-active filter and a 0.5-kVA shunt-active filter. The dc links of both active filters are connected to a common dc capacitor of 2000 F. The 12-pulse thyristor bridge rectifier is considered a voltage-flicker/imbalance-sensitive load identical to a dc power supply for super-conductive material tests. The power circuit of the 1.5-kVA series-active filter consists of three single-phase H-bridge voltage-fed pulse-width-modulation (PWM) inverters using four insulated gate bipolar transistors (IGBT's) in each phase. The operation of the series-active filter greatly forces all the current harmonics produced by the thyristor rectifier into an existing shunt-passive filter of 10 kVA.

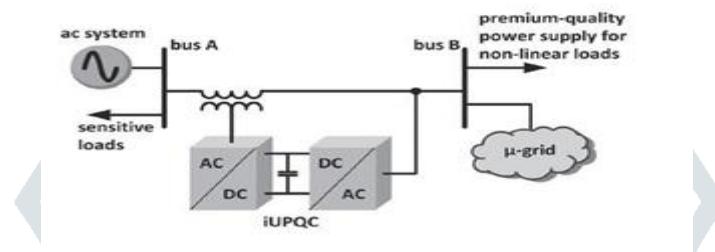


Fig. 1 General UPQC

It also has the capability of damping series/parallel resonance between the supply impedance and the shunt-passive filter. The 0.5-kVA shunt-active filter consisting of a three-phase voltage-fed PWM inverter is connected in parallel to the supply by a step-up transformer. The only objective of the shunt-active filter is to regulate the dc-link voltage between both active filters.

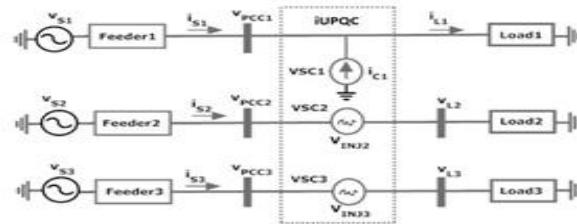


Fig. 2 System configuration of UPQC

With the development in the process control and digital electronics communications, a number of sensitive critical loads which require sinusoidal supply voltage for their proper operation are extensively used. It is well established by the application of custom power controllers in distribution sector that power quality can be significantly improved. A unified power quality conditioner (UPQC) which integrates a series and a shunt active power filters is used to mitigate voltage and current imperfections in a distribution feeder. The shunt compensator of UPQC compensates for load current related problems such as current harmonic unbalance, power factor correction and reactive power required by the load while the series compensator can compensate for all voltage related problems such as voltage sag/swell, voltage harmonics etc.

Many researchers have shown that UPQC as a versatile device to improve the power quality in distribution systems. A novel power quality conditioner for three-feeder distribution systems, called as UPQC which is realized by three single-phase three-level VSCs connected back-to-back by a common dc link capacitor. One VSC is connected in shunt to a feeder through a coupling transformer and the other two VSCs, each in series with a feeder, are connected to the other two feeders through injection transformers. As there is no published work on the UPQC, it is essential to establish the validity of its compensation performance in distribution or industrial networks. A new controller strategy based on synchronous reference frame for series compensators is also proposed. Essentially the proposed UPQC accomplishes the following:

- The shunt VSC compensates current harmonics and reactive power required by one feeder. It also supports the real power required by the other two VSCs and regulates the voltage of dc link capacitor.
- The two series VSCs mitigates voltage waveform distortion, voltage sag/swell and interruptions (protect the sensitive loads connected to the other two feeders against voltage imperfections).

3. STATIC SYNCHRONOUS COMPENSATOR (STATCOM)

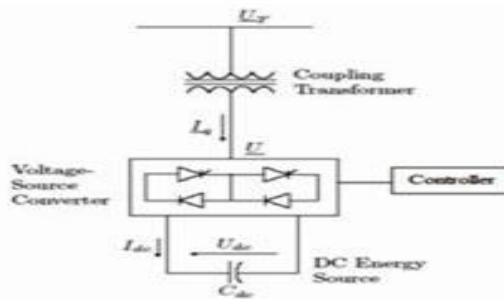


Fig. 3 Structure of a STATCOM

Basically, STATCOM is comprised of three main parts are, a voltage source converter (VSC), a step-up coupling transformer, and a controller. In a very-high-voltage system, the leakage inductances of the step-up power transformers can function as coupling reactors. The main purpose of the coupling inductors is to filter out the current harmonic components that are generated mainly by the pulsating output voltage of the power converters.

A. Control of STATCOM: The controller of a STATCOM operates the converter in a particular way that the phase angle between the converter voltage and the transmission line voltage is dynamically adjusted and synchronized so that the STATCOM generates or absorbs desired VAR at the point of coupling connection.

The STATCOM with a converter voltage source U_1 and a tie connected to a system with a voltage source, and a Thevenin's reactance, $X_{TIE}_THV_{TH}$.

B. Operating Principles Of STATCOM: The STATCOM is connected to the power system at a PCC (point of common coupling), through a step-up coupling transformer, where the voltage-quality problem is a concern. The PCC is also known as the terminal for which the terminal voltage is U_T .

All required voltages and currents are measured and are fed into the controller to be compared with the commands. The controller then performs feedback control and outputs a set of switching signals (firing angle) to drive the main semiconductor switches of the power converter accordingly to either increase the voltage or to decrease it accordingly. A STATCOM is a controlled reactive-power source. It provides voltage support by generating or absorbing reactive power at the point of common coupling without the need of large external reactors or capacitor banks.

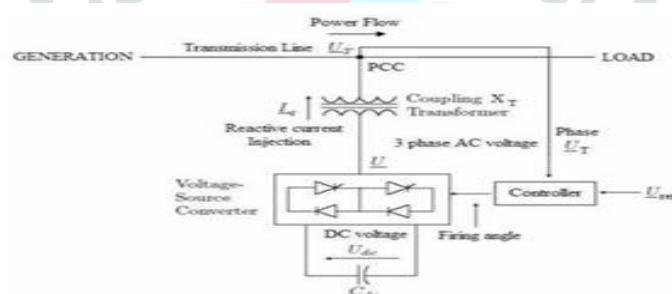


Fig. 4 STATCOM operation in a power system

The charged capacitor C_{dc} provides a DC voltage, U_{dc} to the converter, which produces a set of controllable three-phase output voltages, U in synchronism with the AC system. The synchronism of the three-phase output voltage with the transmission line voltage has to be performed by an external controller. The amount of desired voltage across STATCOM, which is the voltage reference, U_{ref} , is set manually to the controller. The voltage control is thereby to match U_T with U_{ref} which has been elaborated. This matching of voltages is done by varying the amplitude of the output voltage U , which is done by the firing angle set by the controller. The controller thus sets U_T equivalent to the U_{ref} .

The reactive power exchange between the converter and the AC system can also be controlled. This reactive power exchange is the reactive current injected by the STATCOM, which is the current from the capacitor produced by absorbing real power from the AC system.

4.UPQC CONTROLLER

In order to clarify the applicability of the improved UPQC controller, depicts an electrical system with two buses in spotlight, i.e., bus A and bus B. Bus A is a critical bus of the power system that supplies sensitive loads and serves as point of coupling of a micro grid. Bus B is a bus of the micro grid, where nonlinear loads are connected, which requires premium-quality power supply. The voltages at buses A and B must be regulated, in order to properly supply the sensitive loads and the nonlinear loads. Moreover, the micro grid connected to the bus B could be a complex system comprising distributed generation, energy management system, and other control systems involving micro grid, as well as smart grid concepts.

In summary, the modified UPQC can provide the following functionalities:

- “smart” circuit breaker as an intertie between the grid and the micro grid;

- energy and power flow control between the grid and the micro grid (imposed by a tertiary control layer for the micro grid);
 - reactive power support at bus A of the power system;
 - voltage/frequency support at bus B of the micro grid;
 - harmonic voltage and current isolation between bus A and bus B (simultaneous grid-voltage and load-current active-filtering capability);
 - Voltage and current imbalance compensation.

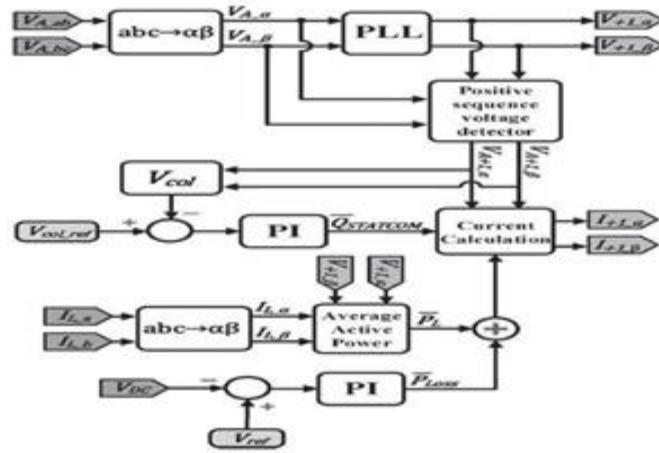


Fig. 5 Control algorithm of UPQC Controller

According to the conventional UPQC controller, the shunt converter imposes a controlled sinusoidal voltage at bus B, which corresponds to the aforementioned functionality. As a result, the shunt converter has no further degree of freedom in terms of compensating active or reactive-power variables to expand its functionality. On the other hand, the series converter of a conventional UPQC uses only an active-power control variable p , in order to synthesize a fundamental sinusoidal current drawn from bus A, corresponding to the active power demanded by bus B. If the dc link of the UPQC has no large energy storage system or even no energy source, the control variable p also serves as an additional active-power reference to the series converter to keep the energy inside the dc link of the UPQC balanced. In this case, the losses in the UPQC and the active power supplied by the shunt converter must be quickly compensated in the form of an additional active power injected by the series converter into the bus B.

First, the simplified Clark transformation is applied to the measured variables. As example of this transformation, the grid voltage in the $\alpha\beta$ -reference frame can be calculated as

$$\begin{bmatrix} V_{A,\alpha} \\ V_{A,\beta} \end{bmatrix} = \begin{bmatrix} 1 & 1/2 \\ 0 & \sqrt{3}/2 \end{bmatrix} \begin{bmatrix} V_{A,ab} \\ V_{A,bc} \end{bmatrix} \dots \dots \dots \dots \dots \dots \dots \quad (1)$$

The series converter synthesizes the current drawn from the grid bus (bus A). In the original approach of UPQC, this current is calculated through the average active power required by the loads P_L plus the power P_{Loss} . The load active power can be estimated by, where $i_{L\alpha}, i_{L\beta}$ are the load currents, and $V_{+I\alpha}, V_{+I\beta}$ are the voltage references for the shunt converter.

This control signal is obtained through a PI controller, in which the input variable is the error between the reference value and the actual aggregate voltage of the grid bus, given by,

The sum of power signals P_L and P_{LOSS} composes the active power control variable for the series converter of the UPQC. Likewise, $Q_{STATCOM}$ is the reactive power control variable. Thus the current references i_{+L_α} and i_{+L_β} of the series converter are determined by,

$$\begin{bmatrix} i_{A+1,\infty} \\ i_{A+1,\beta} \end{bmatrix} = \frac{1}{V_{A+1,\infty}^2 + V_{A+1,\beta}^2} \begin{bmatrix} V_{A+1,\infty} & V_{A+1,\beta} \\ V_{A+1,\beta} & -V_{A+1,\infty} \end{bmatrix} \times \begin{bmatrix} \bar{P}_L + \bar{P}_{LOSS} \\ \bar{Q}_{STATCOM} \end{bmatrix} \dots (4)$$

The following procedure, based on the average power flow, is useful for estimating the power ratings of the UPQC converters. For combined series–shunt power conditioners, such as the UPQC and the UPQC, only the voltage sag/swell disturbance and the power factor (PF) compensation of the load produce a circulating average power through the power conditioners.

The compensation of a voltage sag/swell disturbance at bus B causes a positive-sequence voltage at the coupling transformer ($V_{\text{series}} \neq 0$), since $VA \neq VB$. Moreover, V_{series} and i_{pb} in the coupling transformer leads to a circulating active power P_{inner} in the UPQC.

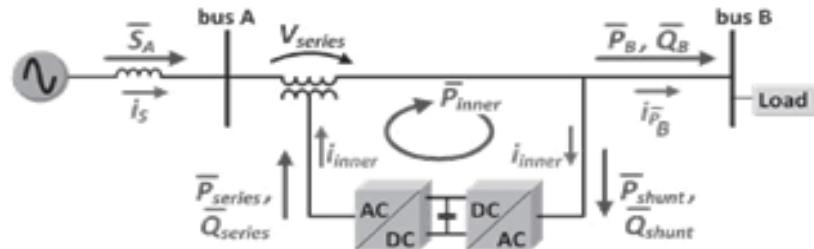


Fig. 6 UPQC power flow in steady state

For the first case, the following average powers in steady state can be determined,

where S_A and Q_A are the apparent and reactive power injected in the bus A, P_B and Q_B are the active and reactive power injected in the bus B, P_{shunt} and Q_{shunt} are the active and reactive power drained by the shunt converter, P_{series} and Q_{series} are the active and reactive power supplied by the series converter, respectively.

If a voltage sag or swell occurs, P_{series} and P_{shunt} will not be zero, and thus, an inner loop current (i_{inner}) will appear. The series and shunt converters and the aforementioned circulating active power (P_{inner}) flow inside the equipment. It is convenient to define the following sag/swell factor. Considering V_N as the nominal voltage

From (5) and considering that the voltage at bus B is kept regulated, i.e., $V_B = V_N$, it follows that

$$\sqrt{3} \cdot k_{\underline{sag}} \cdot V_N \cdot i_S = \sqrt{3} \cdot V_N \cdot i_{P_B}$$

The circulating power is given by

$$\overline{P}_{inner} = \overline{P}_{series} = \overline{P}_{shunt} = 3(V_B - V_N)(i_{P_n} + i_{inner}) \dots \dots (12)$$

From (11) and (13), it follows that

From (11) and (15), it follows that

Thus, (14) demonstrates that P_{inner} depends on the active power of the load and the sag/swell voltage disturbance. In order to verify the effect on the power rate of the series and shunt converters, a full load system 1 p.u. with PF ranging from 0 to 1 was considered. It was also considered the sag/swell voltage disturbance at bus A ranging $k_{sag/swell}$ from 0.5 to 1.5. In this way, the power rating of the series and shunt converters are obtained through (6)–(8) and (14). If the UPQC performs all original UPQC functionalities together with the STATCOM functionality, the voltage at bus A is also regulated with the same phase and magnitude, that is, $V_A V_B V_N$, and then, the positive sequence of the voltage at the coupling transformer is zero ($V_{series} = 0$). Thus, in, steady state, the power flow is determined by

$$\bar{S}_1 = \bar{P}_n + \bar{Q} \quad (15)$$

$$\bar{\theta} = \bar{\theta}_+ + \bar{\theta}_- \quad (16)$$

$$\frac{d}{dt} = 0 \text{ var} \quad (17)$$

Where QSTATCOM is the reactive power that provides voltage regulation at bus A. Ideally, the STATCOM functionality mitigates the inner-loop active power flow (P_{inner}), and the power flow in the series converter is zero. Consequently, if the series converter is properly designed along with the coupling transformer to synthesize the controlled currents I_{+1_a} and I_{+1_b} , as shown in Fig. 3, then a lower power converter can be employed. Contrarily, the shunt converter still has to provide the full reactive power of the load and also to drain the reactive power injected by the series converter to regulate the voltage at bus A.

5. EXPERIMENTAL RESULTS

The improved UPQC controller, was verified in a 5-KVA prototype, whose parameters are presented below. The controller was embedded in a fixed-point digital signal processor (TMS320F2812). In order to verify all the power quality issues described in this project, the UPQC was connected to a grid with a voltage sag system. The voltage sag system was composed by an inductor (L_s), a resistor (R_{rmSag}), and breaker (S_{Sag}). To cause a voltage sag at bus A, S_{Sag} is closed.

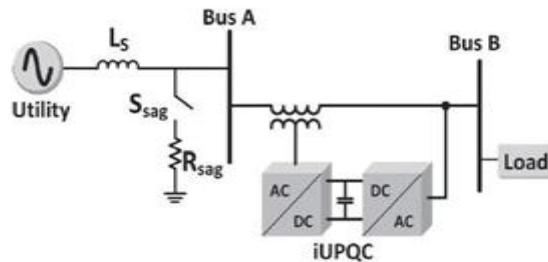


Fig. 7 UPQC experimental scheme

At first, the source voltage regulation was tested with no load connected to bus B. In this case, the UPQC behaves as a STATCOM, and the breaker S_{Sag} is closed to cause the voltage sag. To verify the grid-voltage regulation, the control of the $Q_{STATCOM}$ variable is enabled to compose (4) at instant $t = 0$ s. In this experimental case, $L_s = 10\text{mH}$, and $R_{rmSag} = 7.5\Omega$. Before the $Q_{STATCOM}$ variable is enabled, only the dc link and the voltage at bus B are regulated, and there is a voltage sag at bus A. After $t = 0$ s, the UPQC starts to draw reactive current from bus A, increasing the voltage until its reference value. The load voltage at bus B is maintained regulated during all the time, and the grid-voltage regulation of bus A has a fast response. Next, the experimental case was carried out to verify the UPQC performance during the connection of a nonlinear load with the UPQC already in operation.

The load is a three-phase diode rectifier with a series R-L load at the dc link ($R=45\Omega$ and $L=22\text{mH}$), and the circuit breaker S_{Sag} is permanently closed, with $aL_s = 10\text{ mH}$ and $R_{rmSag}=15\Omega$. In this way, the voltage-sag disturbance is increased due to the load connection. It is possible to verify that the UPQC is able to regulate the voltages at both sides of the UPQC, simultaneously.

Even after the load connection, at $t = 0$ s, the voltages are still regulated, and the currents drawn from bus A are almost sinusoidal. Hence, the UPQC can perform all the power-quality compensations, as mentioned before, including the grid-voltage regulation. It is important to highlight that the grid-voltage regulation is also achieved by means of the improved UPQC controller.

Finally, the same procedure was performed with the connection of a two-phase diode rectifier, in order to better verify the mitigation of power quality issues.

The diode rectifier has the same dc load ($R=45\Omega$ and $L=22\text{mH}$) and the same voltage sag ($L_s=10\text{ mH}$ and $R_{rmSag}=15\Omega$). Fig.9 depicts the transitory response of the load connection. Despite the two-phase load currents, after the load connection at $t = 0$ s, the three-phase current drained from the grid has a reduced unbalanced component. Likewise, the unbalance in the voltage at bus A is negligible.

Unfortunately, the voltage at bus B has higher unbalance content. These components could be mitigated if the shunt compensator works as an ideal voltage source, i.e., if the filter inductor could be eliminated. In this case, the unbalanced current of the load could be supplied by the shunt converter, and the voltage at the bus B could be exactly the voltage synthesized by the shunt converter. Therefore, without filter inductor, there would be no unbalance voltage drop in it and the voltage at bus B would remain balanced. However, in a practical case, this inductor cannot be eliminated, and an improved PWM control to compensate voltage unbalances.

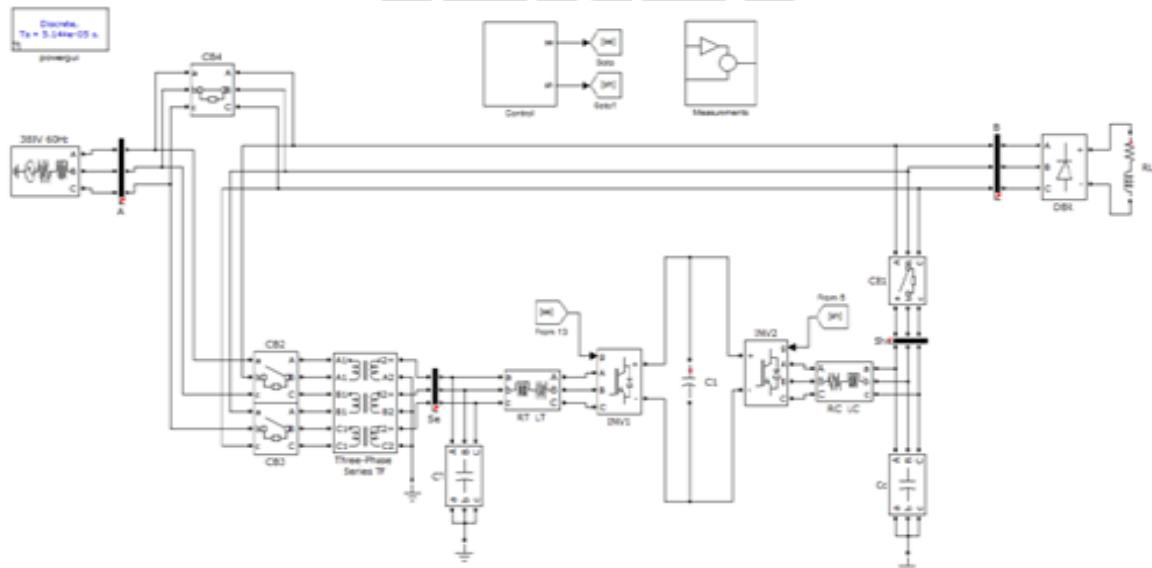


Fig. 8 Simulation circuit

TABLE I
IUPQC PROTOTYPE PARAMETERS

Parameter	Value
Voltage	220 V rms
Grid frequency	60 Hz
Power rate	5 kVA
DC-link voltage	450 V dc
DC-link capacitors	$C = 9400 \mu F$
Shunt converter passive filter	$L = 750 \mu H$ $R = 3.7 \Omega$ $C = 20.0 \mu F$
Series converter passive filter	$L = 1.0 mH$ $R = 7.5 \Omega$ $C = 20.0 \mu F$
Sampling frequency	19440 Hz
Switching frequency	9720 Hz
PI controller (P_{loss})	$K_p = 4.0$ $K_i = 250.0$
PI controller ($Q_{STATCOM}$)	$K_p = 0.5$ $K_i = 50.0$

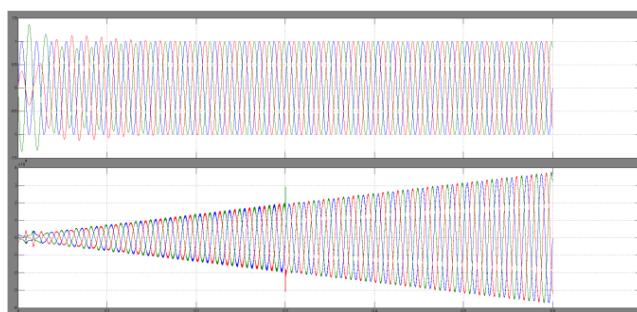


Fig. 9 Controlled outputs of UPQC

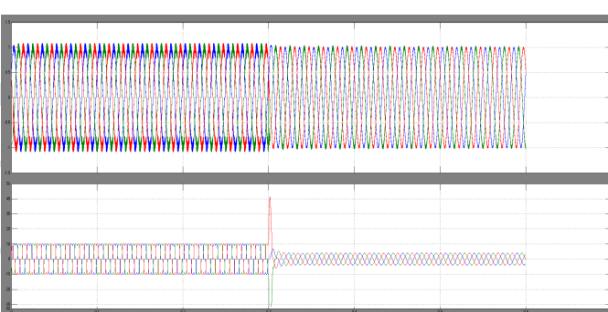


Fig. 10 Measured outputs of UPQC



Fig. 11 Three phase positive sequence Active & Reactive power outputs

6. CONCLUSION

In the improved UPQC controller, the currents synthesized by the series converter are determined by the average active power of the load and the active power to provide the dc-link voltage regulation, together with an average reactive power to regulate the grid-bus voltage. In this manner, in addition to all the power-quality compensation features of a conventional UPQC or an UPQC, this improved controller also mimics a STATCOM to the grid bus. This new feature enhances the applicability of the UPQC and provides new solutions in future scenarios involving smart grids and micro grids, including distributed generation and energy storage systems to better deal with the inherent variability of renewable resources such as solar and wind power. Moreover, the improved UPQC controller may justify the costs and promotes the UPQC applicability in power quality issues of critical systems, where it is necessary not only an UPQC or a STATCOM, but both, simultaneously. Despite the addition of one more power-quality compensation feature, the grid-voltage regulation reduces the inner-loop circulating power inside the UPQC, which would allow lower power rating for the series converter. The experimental results verified the improved UPQC goals. The grid-voltage regulation was achieved with no load, as well as when supplying a three-phase nonlinear load. These results have demonstrated a suitable performance of voltage regulation at both sides of the UPQC, even while compensating harmonic current and voltage imbalances.

7. REFERENCES

- [1] K. Karanki, G. Geddada, M. K. Mishra, and B. K. Kumar, "A modified three-phase four-wire UPQC topology with reduced DC-link voltage rating," *IEEE Trans. Ind. Electron.*, vol. 60, no. 9, pp. 3555–3566, Sep. 2013.
- [2] V. Khadkikar and A. Chandra, "A new control philosophy for a unified power quality conditioner (UPQC) to coordinate load-reactive power demand between shunt and series inverters," *IEEE Trans.*
- [3] Power Del., vol. 23, no. 4, pp. 2522–2534, Oct. 2008. K. H. Kwan, P. L. So, and Y. C. Chu, "An output regulation-based unified power quality conditioner with Kalman filters," *IEEE Trans. Ind. Electron.*, vol. 59, no. 11, pp. 4248–4262, Nov. 2012.

- [4] J. A. Munoz et al., "Design of a discrete-time linear control strategy for multicell UPQC," IEEE Trans. Ind.Electron., vol. 59, no. 10, pp. 3797– 3807, Oct. 2012.
- [5] V. Khadkikar and A. Chandra, "UPQC-S: A novel concept of simultaneous voltage sag/swell and load reactive power compensations utilizing series inverter of UPQC," IEEE Trans. Power Electron., vol. 26, no.9, 2414–2425, Sep. 2011.
- [6] V. Khadkikar, "Enhancing electric power quality using UPQC: A comprehensive overview," IEEE Trans. Power Electron., vol. 27, no. 5, 2284–2297, May 2012.
- [7] L. G. B. Rolim, "Custom power interfaces for renewable energy sources," in Proc. IEEE ISIE, 2007, pp. 2673–2678.
- [8] N. Voraphonpiput and S. Chatratana, "STATCOM analysis and controller design for power system voltage regulation," in Proc. IEEE/PES Transmiss.Distrib. Conf. Exhib.—Asia Pac., 2005, pp. 1–6.
- [9] J. J. Sanchez-Gasca, N. W. Miller, E. V. Larsen, A. Edris, and A. Bradshaw, "Potential benefits of STATCOM application to improve generation station performance," in Proc. IEEE/PESTransmiss. Distrib. Conf. Expo., 2001, vol. 2, pp. 1123–1128.

